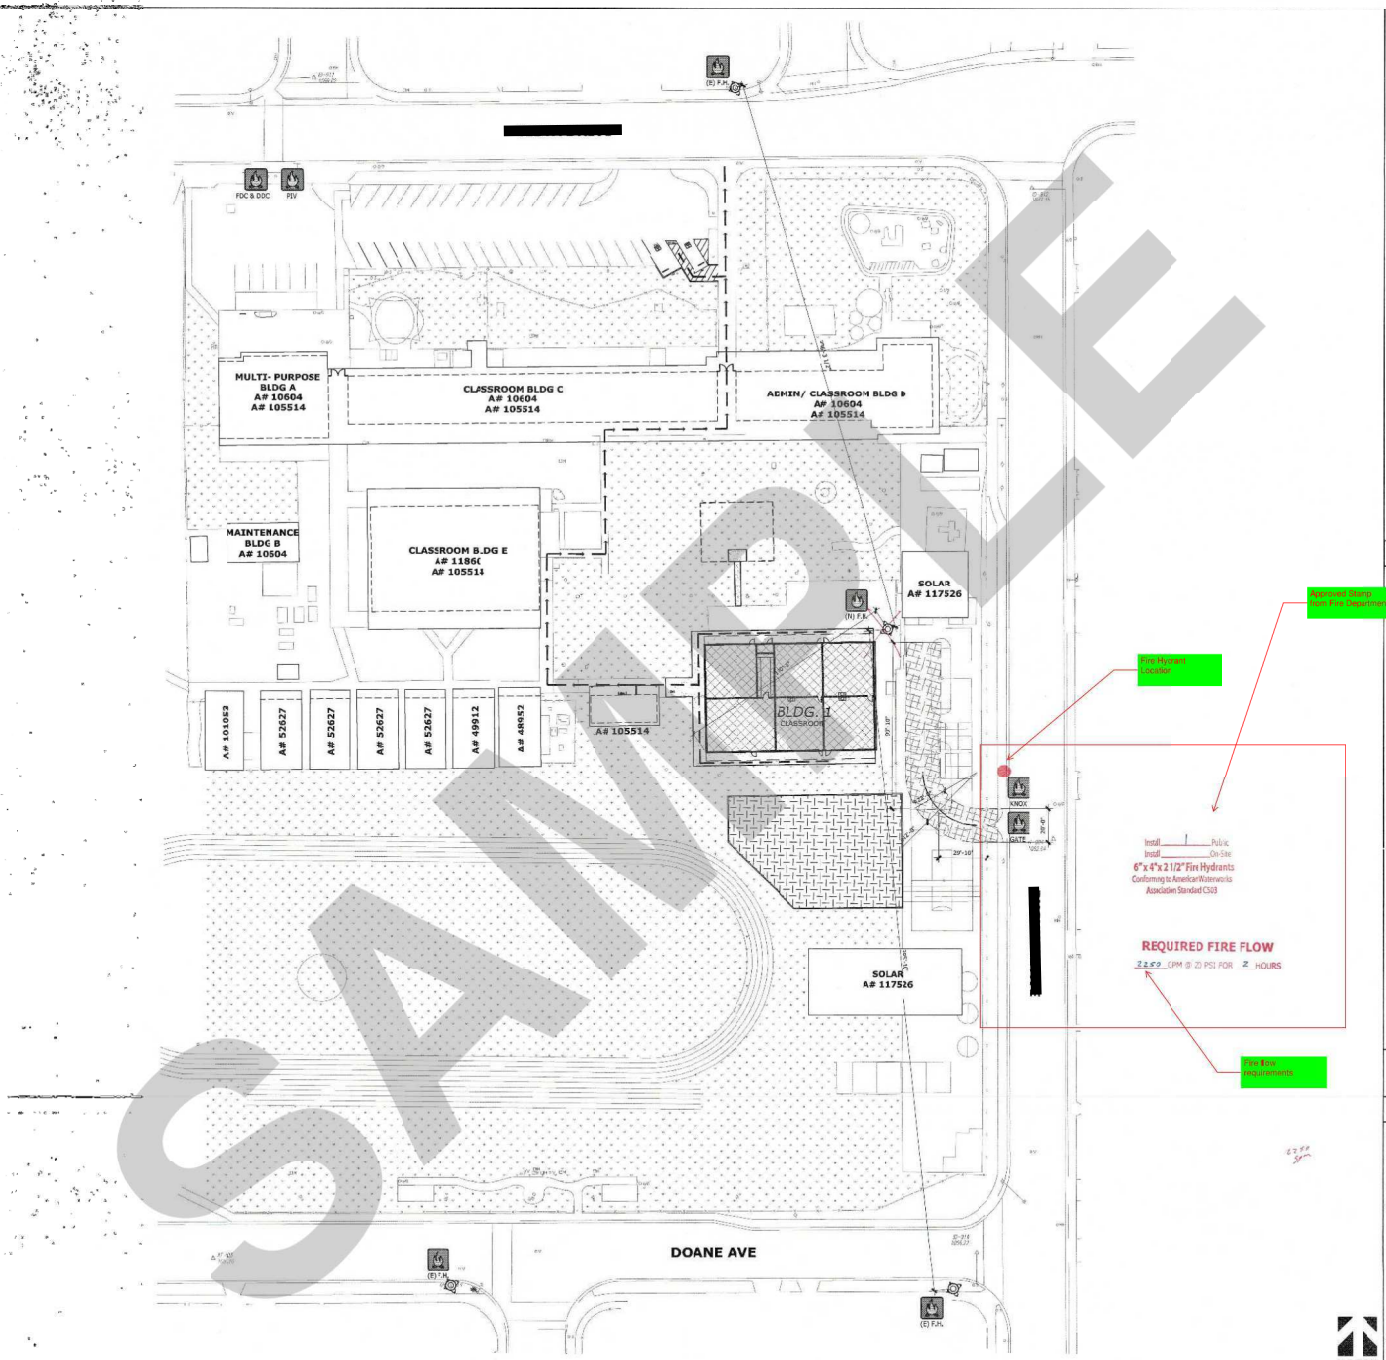

FIRE ACCESS GATE.
GATE
FIRE HYDRANT
(E) F.H.
APPROVED LOCKBOX. (MINIMUM KNOX BOX 3200 SERIES MODEL)
KNOX
POST INDICATOR VALVE
PIV
FIRE DEPT. CONNECTION & DOUBLE DETECTOR CHECK APPARATUS
FDC & DDC
NEW MODULAR BUILDING
(N) CONCRETE PAVING
(N) PLAYGROUND AREA
(E) BUILDING
(E) LANDSCAPE
INDICATES ASSUMED PROPERTY LINE.





NOTE: 20'-0" MIN. WIDE FIRE TRUCK ACCESS LANE NOT TO HAVE LESS THAN 13'-6" VERTICAL CLEARANCE PER 2316 C.F.C.

COUNTY OF LOS ANGELES FIRE DEPARTMENT
FIRE APPARATUS STANDARD PUMPER TURN-AROUND

FIRE DEPT. ACCESS LEGEND NTS

DSA 810

LOCAL FIRE AUTHORITY REVIEW

To facilitate the Division of the State Architect's (DSA) approval the Fire/Life Safety portion of a project, DSA requires Local Fire Authority (LFA) review of certain elements in compliance with this code. Use of this form is mandatory for projects that add square footage to a campus or if any item on this form is relevant to the project. For additional information, see DSA 810 Instructions and DSA Policy No.01

PROJECT INFORMATION

School District/Owner:
Project Name/School:
Project Address:

LOCAL FIRE AUTHORITY (LFA)

LFA Agency Name: LOS ANGELES COUNTY FIRE DEPARTMENT-FAST REGION POMONA OFFICE
LFA Reviewer's Name: Title:
Phone: Tele/Area Number:

I have reviewed and responded to the applicable items for this project as listed below.
Note: Only sign this form when it is shaped once the site plan / base form is not acceptable to DSA.

LFA Reviewer's Signature: Date:

Review Key: "Y" = Complies with LFA requirements "N" = Not approved (complete Section B)
"NA" = Not applicable to the project "NR" = LFA elects not to review

	Description	Y	N	NA	NR
1	Where an elevator does not meet medical emergency service use, per the California Building Code (CBC), use of stairways for emergency rescue and patient transport is acceptable.				
2	Access roads, fire lane markings, gates and gate entrances are in accordance with Title 19, California Code of Regulations and the California Fire Code, Chapter 5.				
3	Fire hydrant location and distribution complies with the California Fire Code (or see # 4)				
4	Fire hydrant location and distribution complies with NFPA 1142, "Alternate Means." ("Y/N" or attached). DSA can only approve on-site water storage upon alternate. The signature of the school district official is required to acknowledge the use of alternate means.				
5	Signature of School District Official: Date: Print the School District Official's Name:				
6	The location(s) of the proposed post indicator valve and fire department connection meet the requirements of this jurisdiction.				
7	The location(s) of the detector/check valve assembly meet the requirements of this jurisdiction.				
8	Is the project located in a hazard severity zone area? (CBC, Chapter 7A, Section 701A.) Check type if "Yes": Wildland Brushland Very High WUIFA (If one of these boxes is checked, the project design must meet the requirements of Chapter 7A.)		Yes		No
9	COMMENTS (note deficiencies):				

DSA 810 (rev 05-12-17) Page 1 of 1
DIVISION OF THE STATE ARCHITECT DEPARTMENT OF GENERAL SERVICES STATE OF CALIFORNIA

FIRE AUTHORITY APPROVAL

File No: 10-21
DEPARTMENT OF THE STATE ARCHITECT
OFFICE OF REGULATION SERVICES
03-118595
AC ___ PLN ___ FR ___
DATE:

STAMPS

RUHNAU CLARKE ARCHITECTS

CONSTRUCTION OF NEW MODULAR BUILDINGS
VISTA DEL VALLE ELEMENTARY
514 BRICKNELL AVE, CLAREMONT, CA 91711
CLAREMONT UNIFIED SCHOOL DISTRICT

FIRE AUTHORITY APPROVAL SITE PLAN **AS-1.4**

LOCAL FIRE AUTHORITY APPROVAL SITE PLAN | 1"=30'-0" | 10

PROJECT No. : 2203
9/28/2018 3:36 PM

RUHNAUCLARKE.COM

SAMPLE

J:\Claremont\ISD_20\2808_VistaDS-HoldenAddition\DRSKWI\2808-PL_AS-1.4-Fire Marshall Site Plan.dwg