


## Water Supply Reliability Self-Certification Acknowledgement Golden State Water's South San Gabriel System

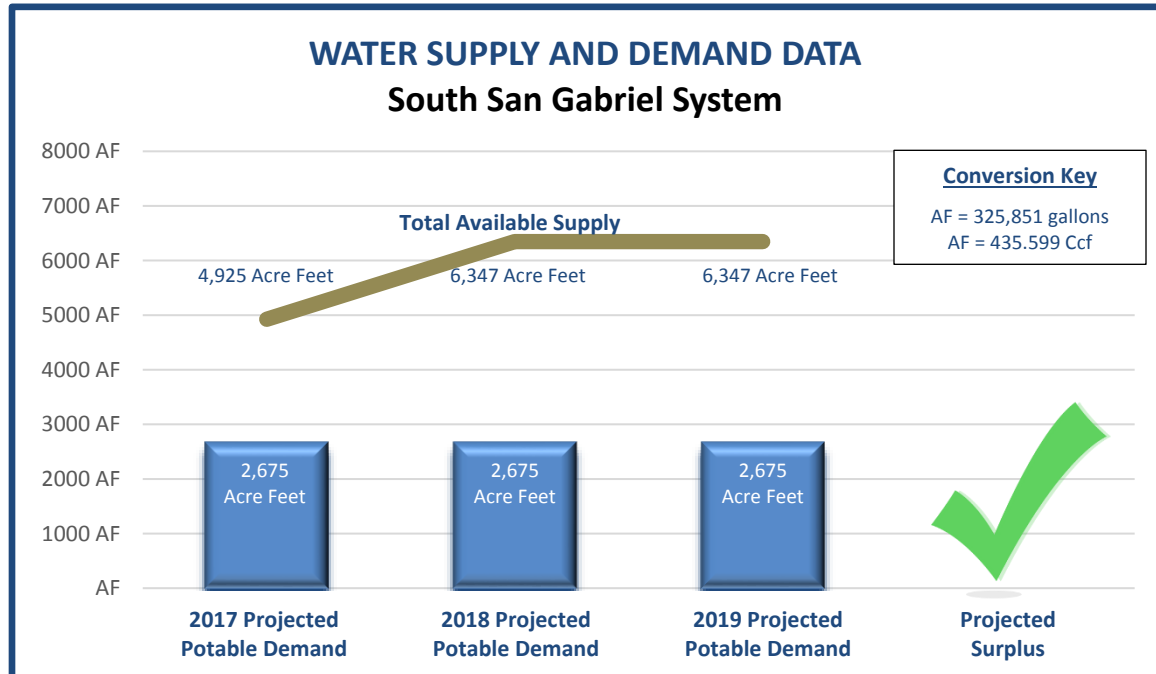

Urban Water Supplier	Golden State Water Company S San Gabriel (771)
2013 Production (in units selected)	2710.8
2014 Production (in units selected)	2640.9
Calculated Annual Potable Water Demand in Acre-feet (AF)	2675.850 AF
WY 2017 Total Available Water Supply	4925 AF
WY 2018 Total Available Water Supply	6347 AF
WY 2019 Total Available Water Supply	6347 AF
Individual or Aggregate	Individual
Conservation Standard *	-137 %
Higher Conservation Standard	No
Step 3.1 Notes and Comments	GSWC customers have done a tremendous job conserving and complying with the State's restrictions during the drought. We encourage all of our communities to continue to using water responsibly and keep the existing conservation momentum. As such, voluntary conservation targets may be proposed in the coming weeks pending actions by the CPUC in their upcoming resolution W-5103 to be heard by the commission on June 23rd. **
Uploaded Worksheet #1	<a href="http://drinc.ca.gov/DNN/Portals/0/SelfCert/aacdf661-919b-4e00-bbde-9ed25ffaf0cc.xlsx">http://drinc.ca.gov/DNN/Portals/0/SelfCert/aacdf661-919b-4e00-bbde-9ed25ffaf0cc.xlsx</a>
Uploaded Supporting Analysis & Calculations	<a href="http://drinc.ca.gov/DNN/Portals/0/SelfCert/18b0028e-74eb-48d5-8023-508074ce8dd7.xlsx">http://drinc.ca.gov/DNN/Portals/0/SelfCert/18b0028e-74eb-48d5-8023-508074ce8dd7.xlsx</a>

\* A negative number indicates a surplus and the Conservation Standard is zero.

\*\* Update: A 10% voluntary conservation target has been implemented for this water system.

If you are unable to view any of the included documents, please contact [customerservice@gswater.com](mailto:customerservice@gswater.com).